RMS WATER HARVESTING SYSTEM DETAIL - AQUABOX

NOT TO SCALE

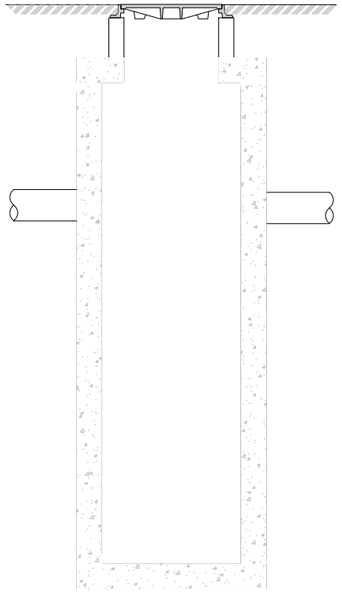

RMS PRETREATMENT DEVICE
(NOTE 1)

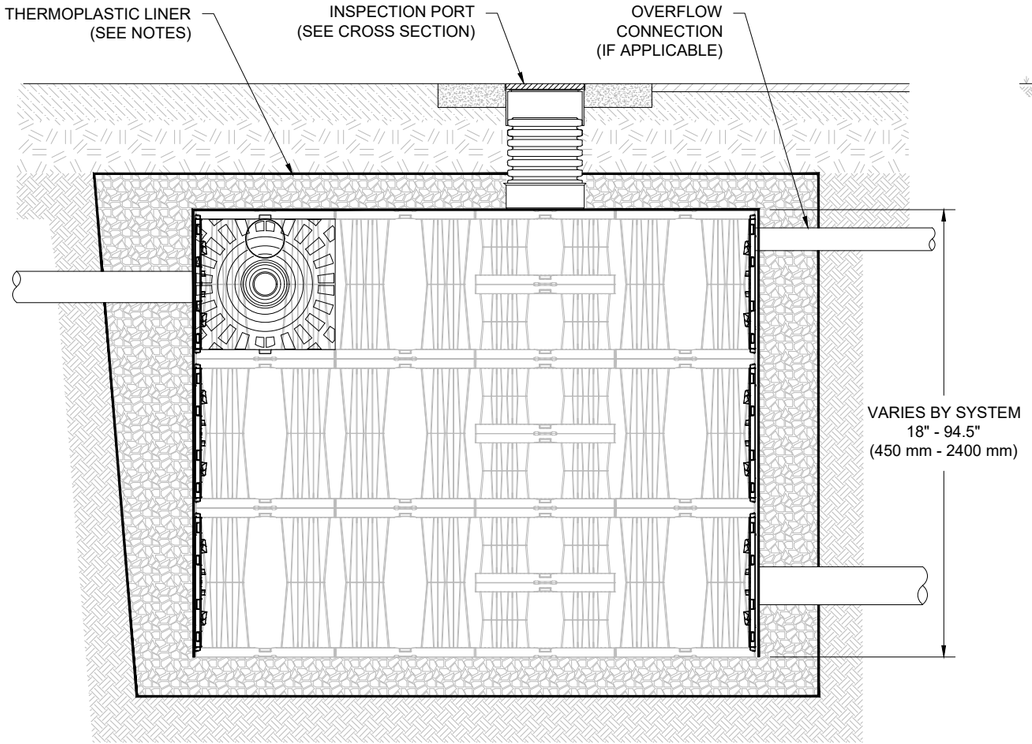

AQUABOX STORAGE SYSTEM

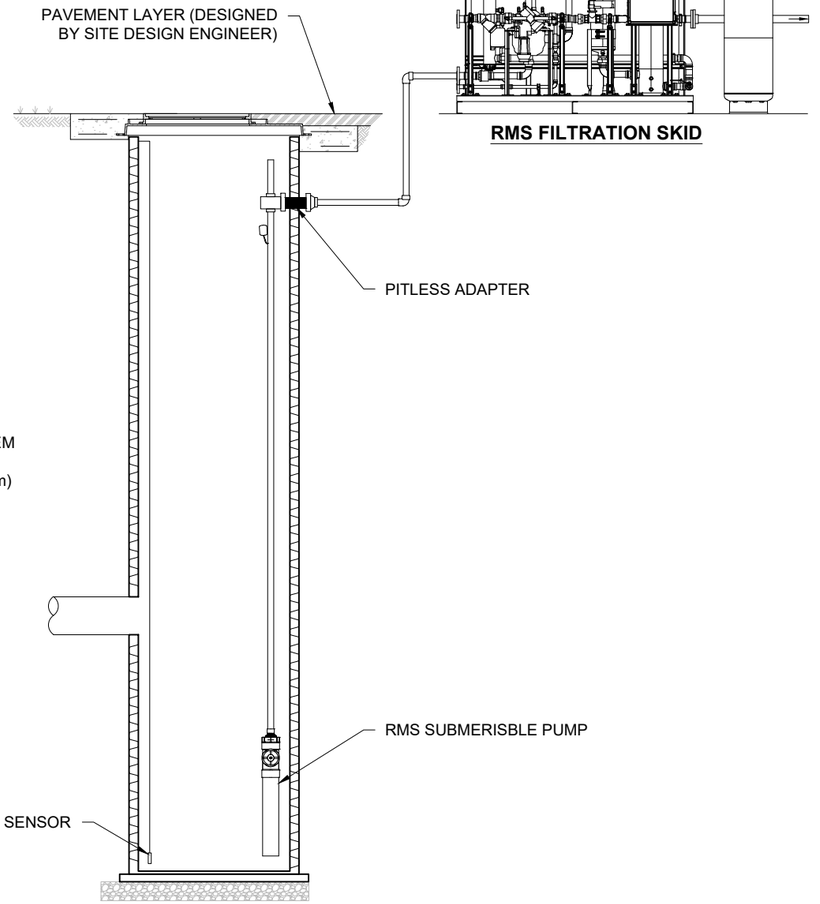

RMS PUMP BASIN
(SHOWN AS HP MANHOLE)

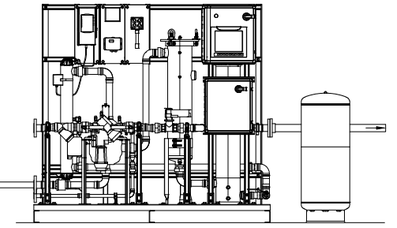

RMS FILTRATION SKID

NOTES:

1. UPSTREAM PRETREATMENT DEVICE AS SPECIFIED BY DESIGN ENGINEER TO MEET LOCAL REGULATORY REQUIREMENTS.
2. ADS DOES NOT DESIGN OR PROVIDE MEMBRANE LINER SYSTEMS. TO MINIMIZE LEAKAGE POTENTIAL OF LINER SYSTEMS, THE MEMBRANE LINER SYSTEMS SHOULD BE DESIGNED BY A KNOWLEDGEABLE GEOTEXTILE PROFESSIONAL AND INSTALLED BY A QUALIFIED CONTRACTOR. TECH NOTE 6.50 MAY BE REFERENCED FOR GENERAL INFORMATION ON MEMBRANE MATERIALS, GEOTEXTILE MATERIALS, AND SEAMING OPTIONS.

RAINWATER HARVESTING
AQUABOX STORAGE
RMS

DATE: 05/18/2026 | DRAWN: SMW | CHECKED:

DRAWING #: 790-770

DATE	DWN	CHK

RMS™ RAINWATER MANAGEMENT SOLUTIONS

4640 TRUEMAN BLVD
HILLIARD, OH 43026

ADS

THIS DRAWING HAS BEEN PREPARED BASED ON INFORMATION PROVIDED TO ADS/STORMTECH UNDER THE DIRECTION OF THE PROJECT'S ENGINEER OF RECORD ("EOR") OR OTHER PROJECT REPRESENTATIVE. THIS DRAWING IS NOT INTENDED FOR USE IN BIDDING OR CONSTRUCTION WITHOUT THE EOR'S PRIOR APPROVAL. EOR SHALL REVIEW THIS DRAWING PRIOR TO BIDDING AND/OR CONSTRUCTION. IT IS THE ULTIMATE RESPONSIBILITY OF THE EOR TO ENSURE THAT THE PRODUCT(S) DEPICTED AND ALL ASSOCIATED DETAILS MEET ALL APPLICABLE LAWS, REGULATIONS, AND PROJECT REQUIREMENTS.