

# INSERTA TEE® MULTIFIT


PVC, IPS, and N-12 options available.  
 -For PVC bell info, refer to STD-1106 (Not Fatboy) & STD-1109  
 -For N-12 bell info, refer to STD-1105  
 -For IPS bell info, refer to STD-1108

## What is the Inserta Tee MultiFit™?

Inserta Tee MultiFits are made for a specific lateral pipe type and size, and fits a size range of a specific mainline type.

PART #	PART NAME
1	PVC HUB
2	ADS VALLEY GASKET (N-12 BELL ONLY)
3	S.S. BAND
4	RUBBER SLEEVE
4A	UPPER SEGMENT
4B	LOWER SEGMENT*
4C	MAINLINE WALL THICKNESS - REFER TO STD 1103

\*WILL NOT APPEAR ON RUBBER SLEEVES FOR CONCRETE OR CLAY PIPE

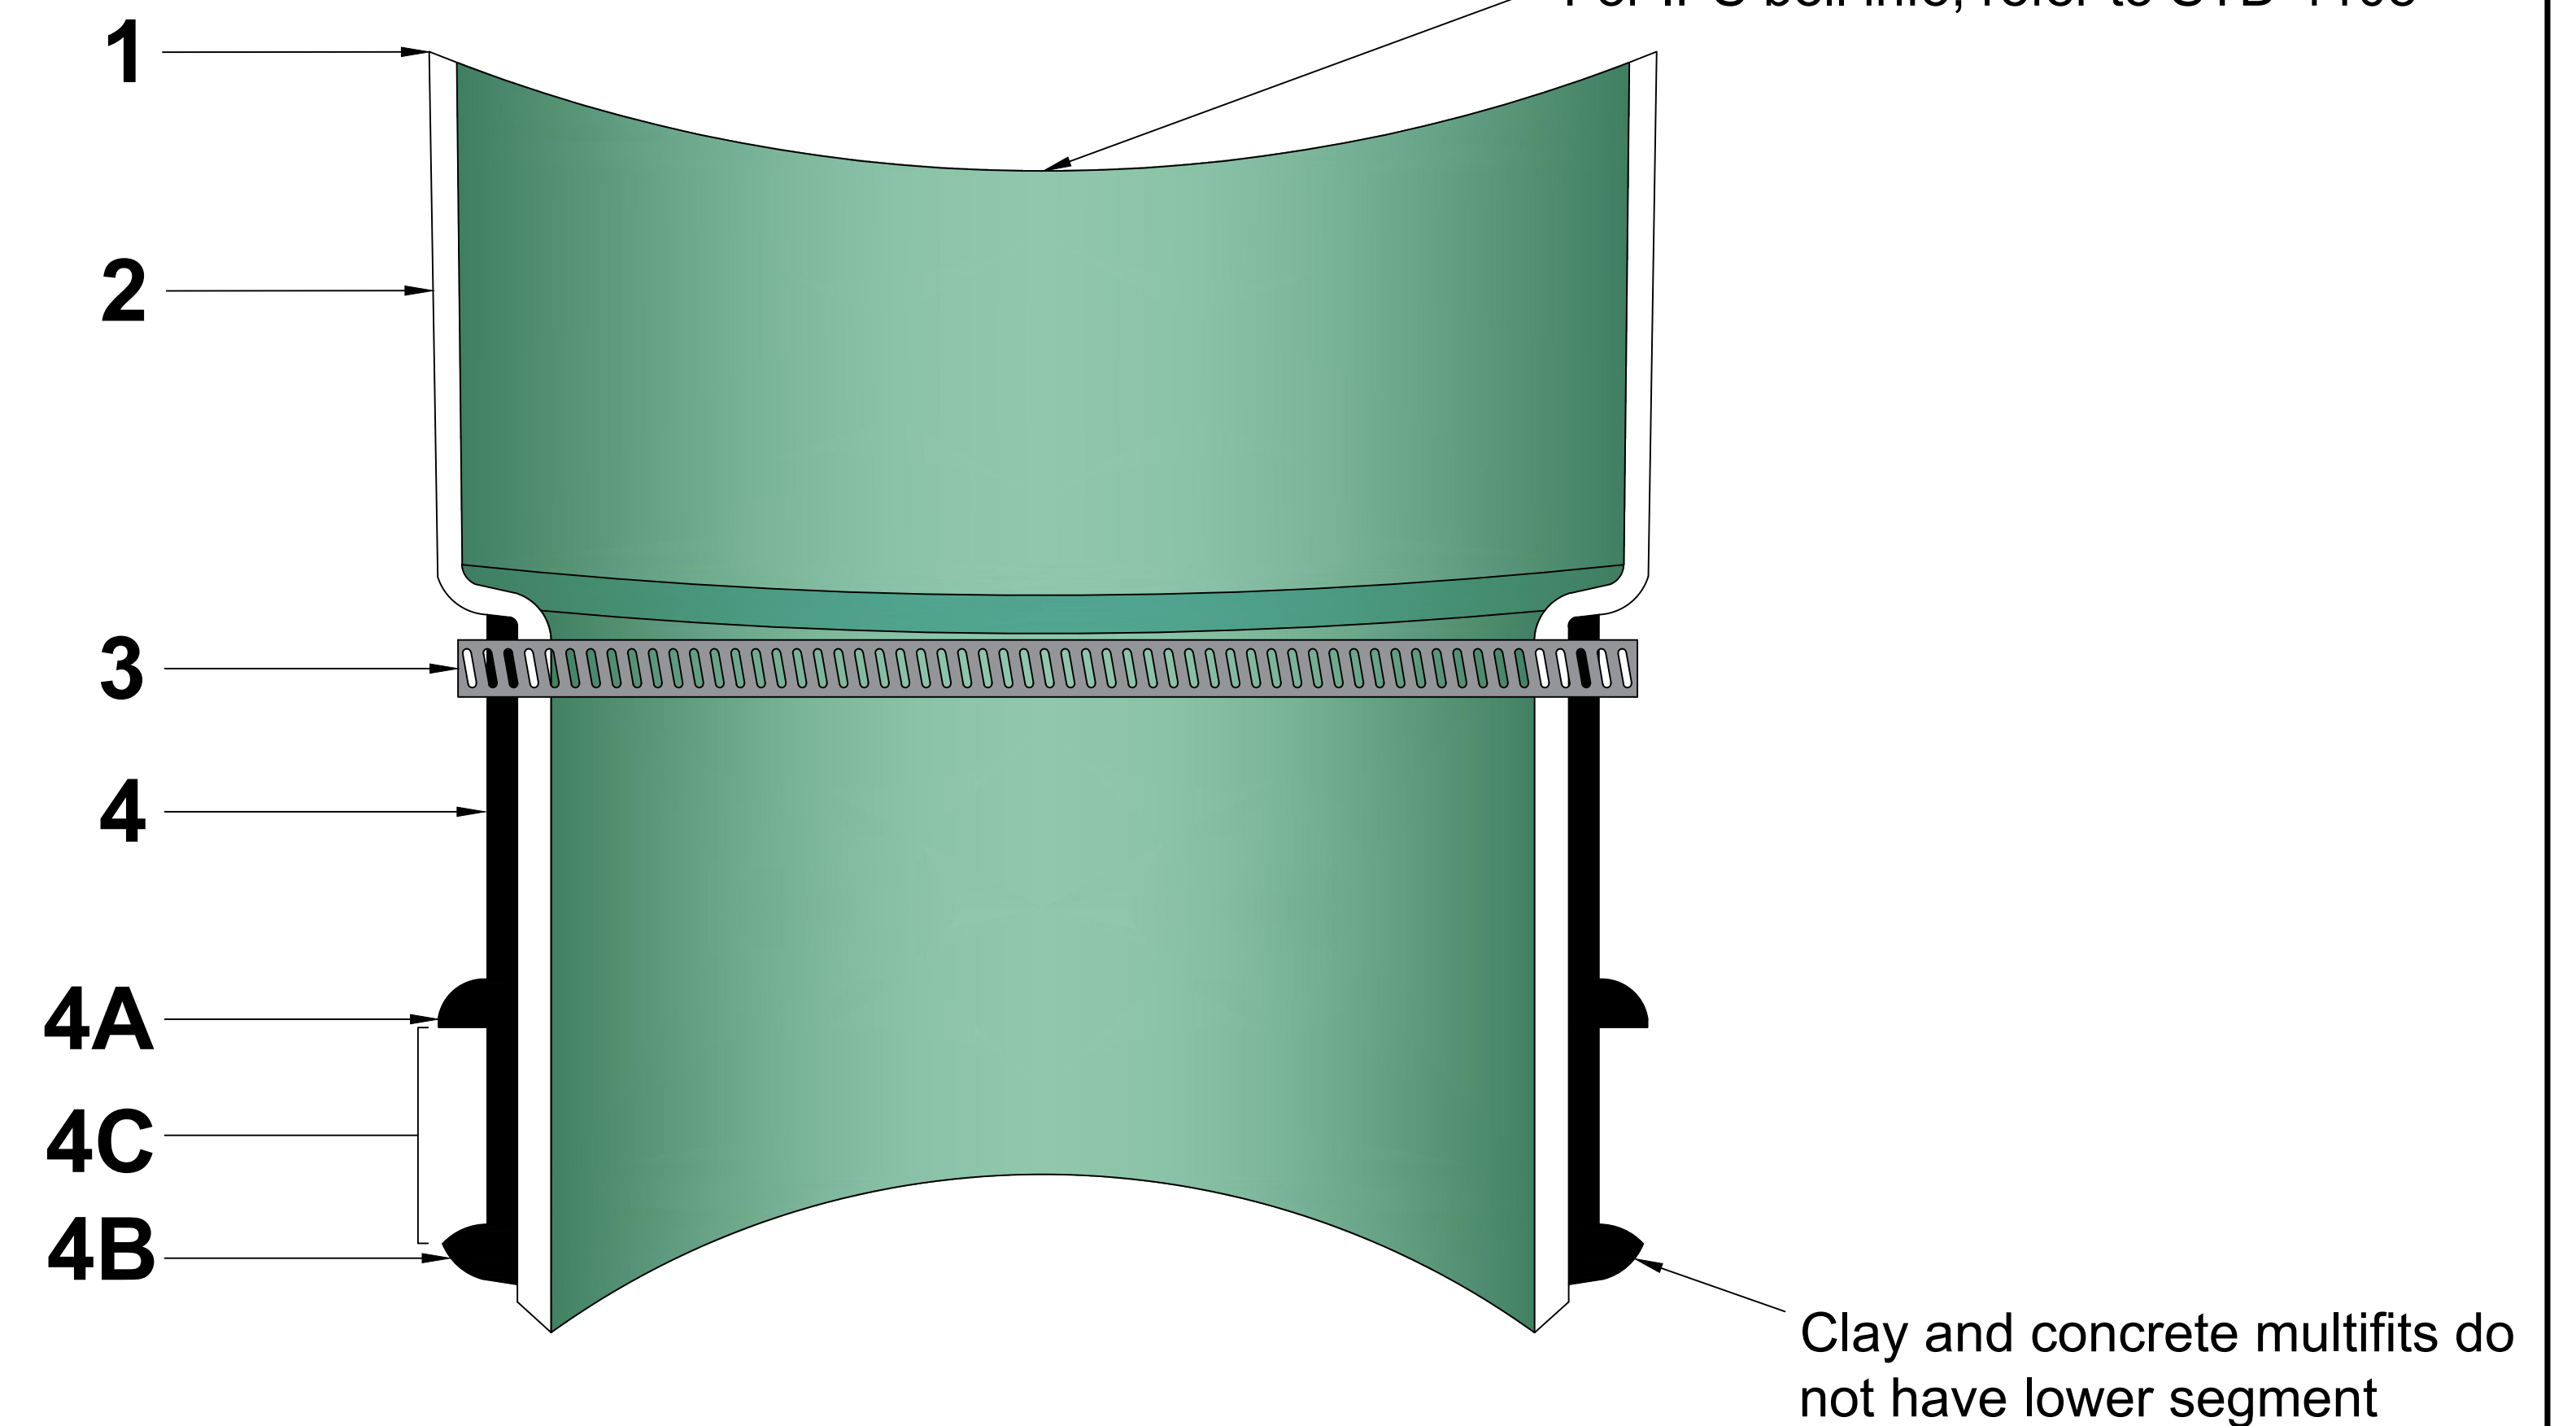

## CONFIGURATION OPTIONS

N12 INTO N12		N12 INTO CONCRETE / CLAY MAINLINES*		SDR35 PVC INTO N12		SDR26/35 PVC INTO CONCRETE / CLAY MAINLINES*		SDR26/35 PVC INTO SDR35 PVC MAINLINES*		IPS / SCH40 PVC INTO N12		IPS / SCH40 PVC INTO CONCRETE / CLAY MAINLINES*		IPS / SCH40 PVC INTO SDR35 PVC MAINLINES	
LATERAL	MAINLINE	LATERAL	MAINLINE	LATERAL	MAINLINE	LATERAL	MAINLINE	LATERAL	MAINLINE	LATERAL	MAINLINE	LATERAL	MAINLINE	LATERAL	MAINLINE
4" - 8"	Use OneFit STD - 1111	4"	10" - 12"	4" - 8"	Use OneFit STD-1111	4" or 6"	10" - 12"	4" or 6"	10" - 12"	4" - 8"	Use OneFit STD-1111	4"	10" - 12"	4" or 6"	10" - 12"
		4" or 6"	15" - 18"				15"+		15" - 18"			15" - 18"	15" - 18"		
		8"	15" - 24"				15" - 24"		12" - 24"			15" - 24"	21" - 24"		
			30"+			(SDR35)	30"+					8"	30"+		27" - 30"
10"	18" - 24"	10"	18" - 24"	10"	18" - 24"	10"	18" - 24"	8"+	Use Traditional Inserta Tee	10"	18" - 24"	10"	18" - 24"	8"+	Use Traditional Inserta Tee
	30" - 60"		30"+		30" - 60"		30" - 60"				30" - 60"		30"+		
12"	18" - 24"	12"	18" - 24"	12"	18" - 24"	12"	18" - 24"	8"+	Use Traditional Inserta Tee	12"	18" - 24"	12"	18" - 24"	8"+	Use Traditional Inserta Tee
	30" - 60"		30"+		30" - 60"		30" - 60"				30" - 60"		30"+		

NOTE: FOR INSTALLATION INSTRUCTIONS, REFER TO DETAIL STD-1100. FOR PROTRUSION INFORMATION, REFER TO DETAIL STD-1101. FOR HOLE SAW INFORMATION, REFER TO DETAIL STD-1102.

ADVANCED DRAINAGE SYSTEMS, INC. ("ADS") HAS PREPARED THIS DETAIL BASED ON INFORMATION PROVIDED TO ADS. THIS DRAWING IS INTENDED TO DEPICT THE COMPONENTS AS REQUESTED. ADS HAS NOT PERFORMED ANY ENGINEERING OR DESIGN SERVICES FOR THIS PROJECT, NOR HAS ADS INDEPENDENTLY VERIFIED THE INFORMATION SUPPLIED. THE INSTALLATION DETAILS PROVIDED HEREIN ARE GENERAL RECOMMENDATIONS AND ARE NOT SPECIFIC FOR THIS PROJECT. THE DESIGN ENGINEER SHALL REVIEW THESE DETAILS PRIOR TO CONSTRUCTION. IT IS THE DESIGN ENGINEERS RESPONSIBILITY TO ENSURE THE DETAILS PROVIDED HEREIN MEETS OR EXCEEDS THE APPLICABLE NATIONAL, STATE, OR LOCAL REQUIREMENTS AND TO ENSURE THAT THE DETAILS PROVIDED HEREIN ARE ACCEPTABLE FOR THIS PROJECT.

INSERTA TEE MULTIFIT

DRAWING NUMBER STD-1112



4640 TRUEMAN BLVD  
 HILLIARD, OH 43026

DRAWN BY: HAK  
 DATE: 07/19/23  
 OK'S BY: ENG  
 SCALE: NTS  
 SHEET: 1