


- NOTES
1. INSTALL TANK, ECOFILTER, AND CONTROL PANEL PER INSTALLATION INSTRUCTION.
 2. THE INLET CAN BE RAISED A MAXIMUM OF 1" TO 48" TO PROVIDE A GREATER VOLUME.

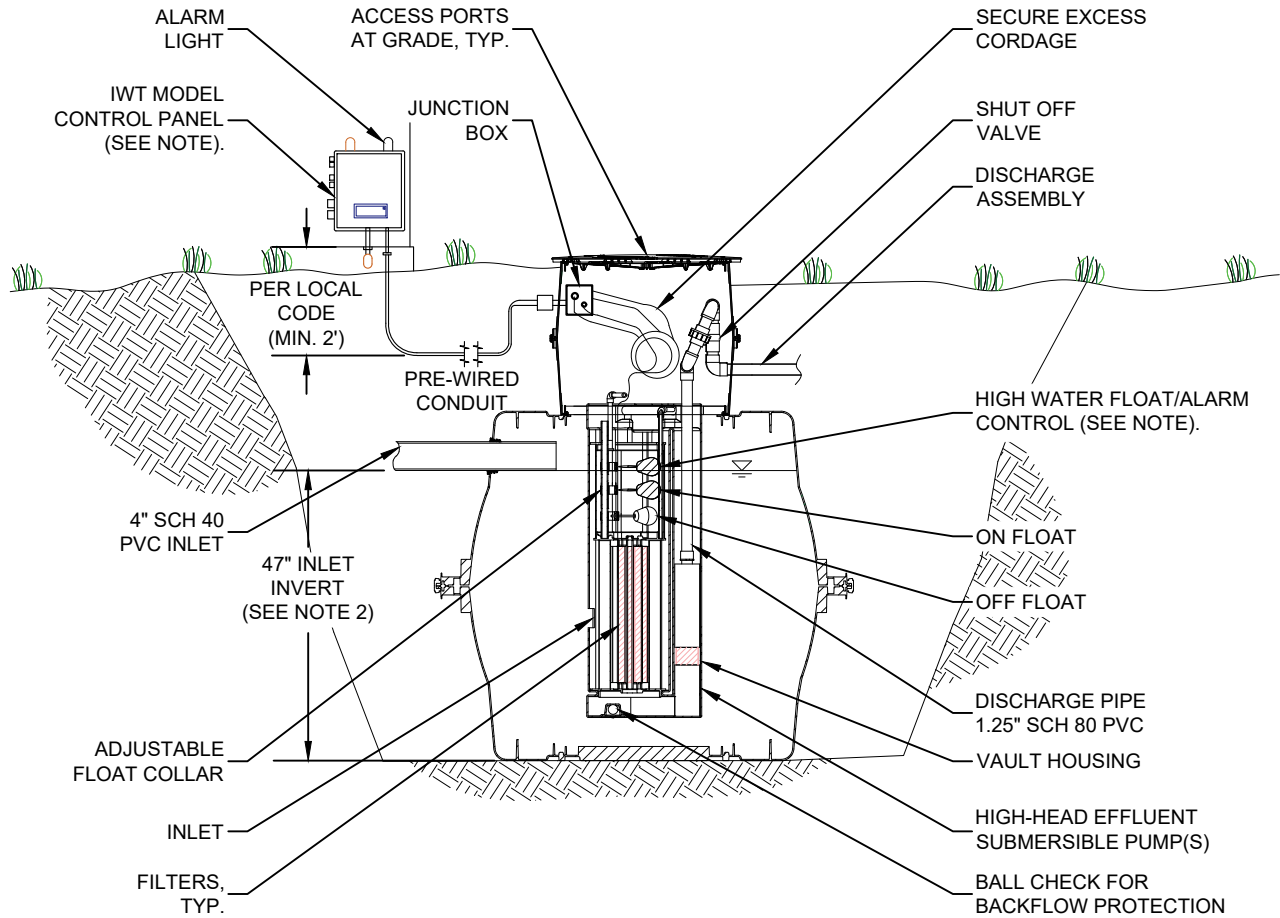

INFILTRATOR WATER TECHNOLOGIES, LLC
4 BUSINESS PARK RD, OLD SAYBROOK, CT 06475
WWW.INFILTRATORWATER.COM
PHONE: (800) 221-4436 / EMAIL: INFO@INFILTRATORWATER.COM

ECOFILTER

ECOFILTER PUMP VAULT 49"
INSTALL WITH IM-540 TANK

PART NO.
P/N
DATE
04/22/2025
SCALE
1:30
SHEET NO.
01 of 01