


STRUCTURE OPTIONS

- FITTING DIMENSIONS VARY WITH UNIT DESIGN, DIMENSIONS CAN BE PROVIDED ONCE DESIGN IS EVALUATED.
- COMBINATIONS OF NYLOPLAST BASINS AND FABRICATED FITTINGS ARE AVAILABLE
- STRUCTURES BY OTHERS MAY BE USED.

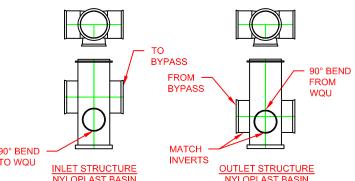

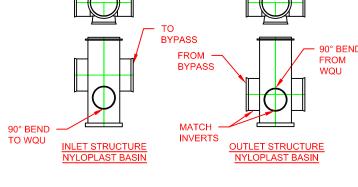

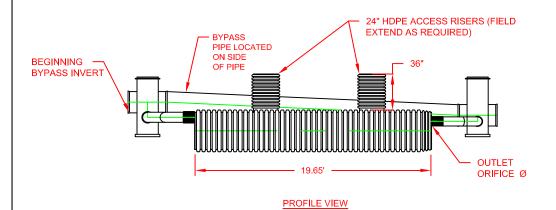

FLOW

PLAN VIEW

HDPE BYPASS

PIPE

24" INSPECTION RISER

SOI-TIGHT OR

COUPLER (TYP)

WATERTIGHT

MODEL#	MAIN PIPE DIA.	SIEVE SIZE	PARTICLE SIZE (CM)	TREATED FLOW RATE (CFS)	INLET Ø	OUTLET Ø	OUTLET ORIFICE Ø	ELEVATION CHANGE*
3620WQAXX	36"	140	0.0106	1.5	10"	10"	7.82"	11.9"
3620WQBXX	36"	200	0.0075	0.7	10"	10"	5.35"	11.9"

XX DENOTES A BY-PASS SIZE OF 12", 15", 18", 24", 30", 36", 42", 48", OR 60" XX=00 DENOTES UNITS W/OUT A BY-PASS.

* ELEVATION CHANGE FOR UNITS WITHOUT A BY-PASS IS 2"

© 2016 ADS, INC.


SHOWN AS NYLOPLAST BASIN. SEE STRUCTURE OPTIONS FOR

ALTERNATE CONFIGURATIONS.

INLET SIDE

(TYP)



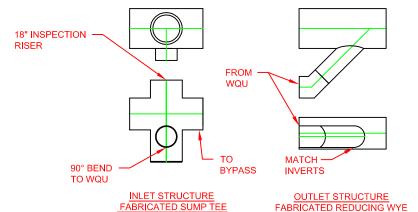

NOTES:

SHOWN AS NYLOPLAST

BASIN. SEE STRUCTURE

CONFIGURATIONS

OUTLET SIDE

OPTIONS FOR ALTERNATE

- 1. SEE STANDARD DETAILS STD-501 AND STD-502 FOR STORM WATER QUALITY UNIT PRODUCT DETAILS.
- 2. REFERENCE TECHNICAL NOTE 1.03 FOR ADDITIONAL DESIGN INFORMATION.
- 3. ELEVATION CHANGE DENOTES THE ELEVATION DROP FROM INVERT OF BYPASS AT INLET TO INVERT OF BYPASS AT OUTLET.

1	FORMATTING UPDATES AND RENAMED	TJR	02/17/16		
REV.	DESCRIPTION	BY	MM/DD/YY	CHK'D	

36in 20ft WQU DRAWING NUMBER: STD-503

4640 TRUEMAN BLVD HILLIARD, OHIO 43026

CKS 7/17/08 NTS OF