


# INSERTA TEE® PARALLEL SPACING DETAIL

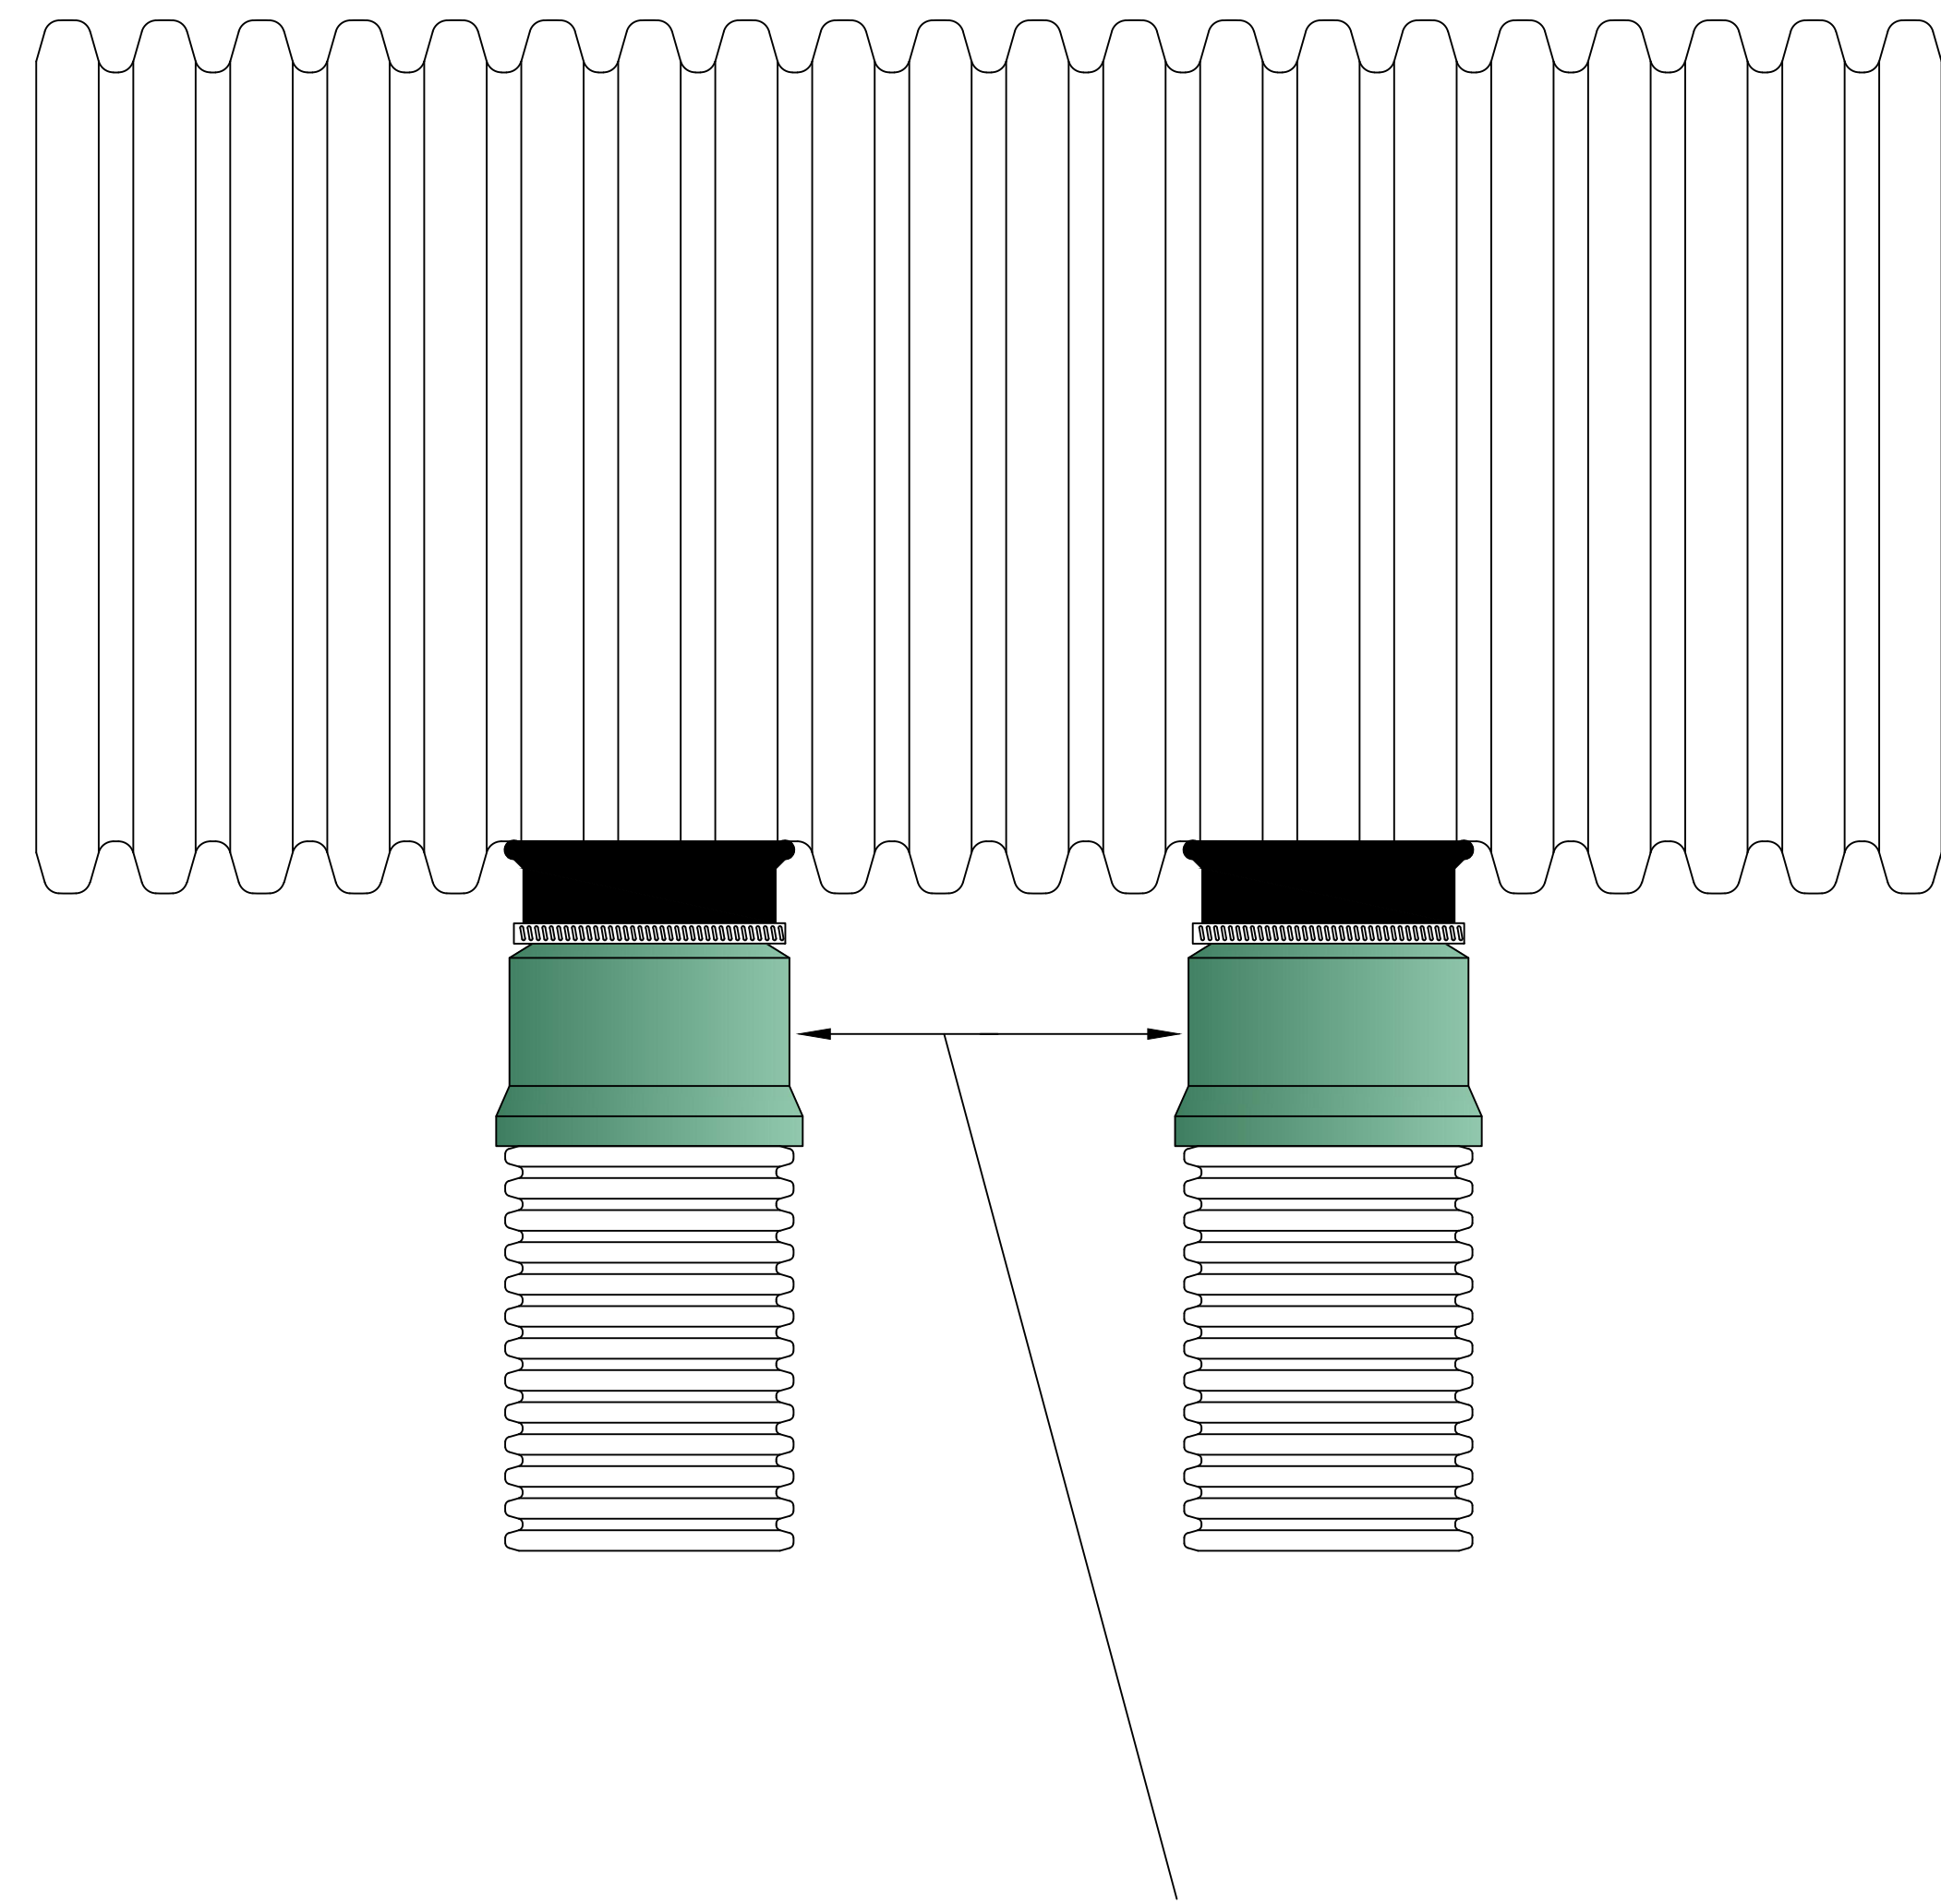


Hub specific details available.

- For N-12 bell info, refer to STD-1105
- For IPS/SCH 40 bell info, refer to STD-1108
- For SDR-35 bell info, refer to STD-1109
- For Fatboy bell info, refer to STD-1106
- For SDR-26 bell info, refer to STD-1110

Additional Inserta Tee product lines can be found here:

For Inserta Tee Onefit, refer to STD-1111

For Inserta Tee Multifit, refer to STD-1112

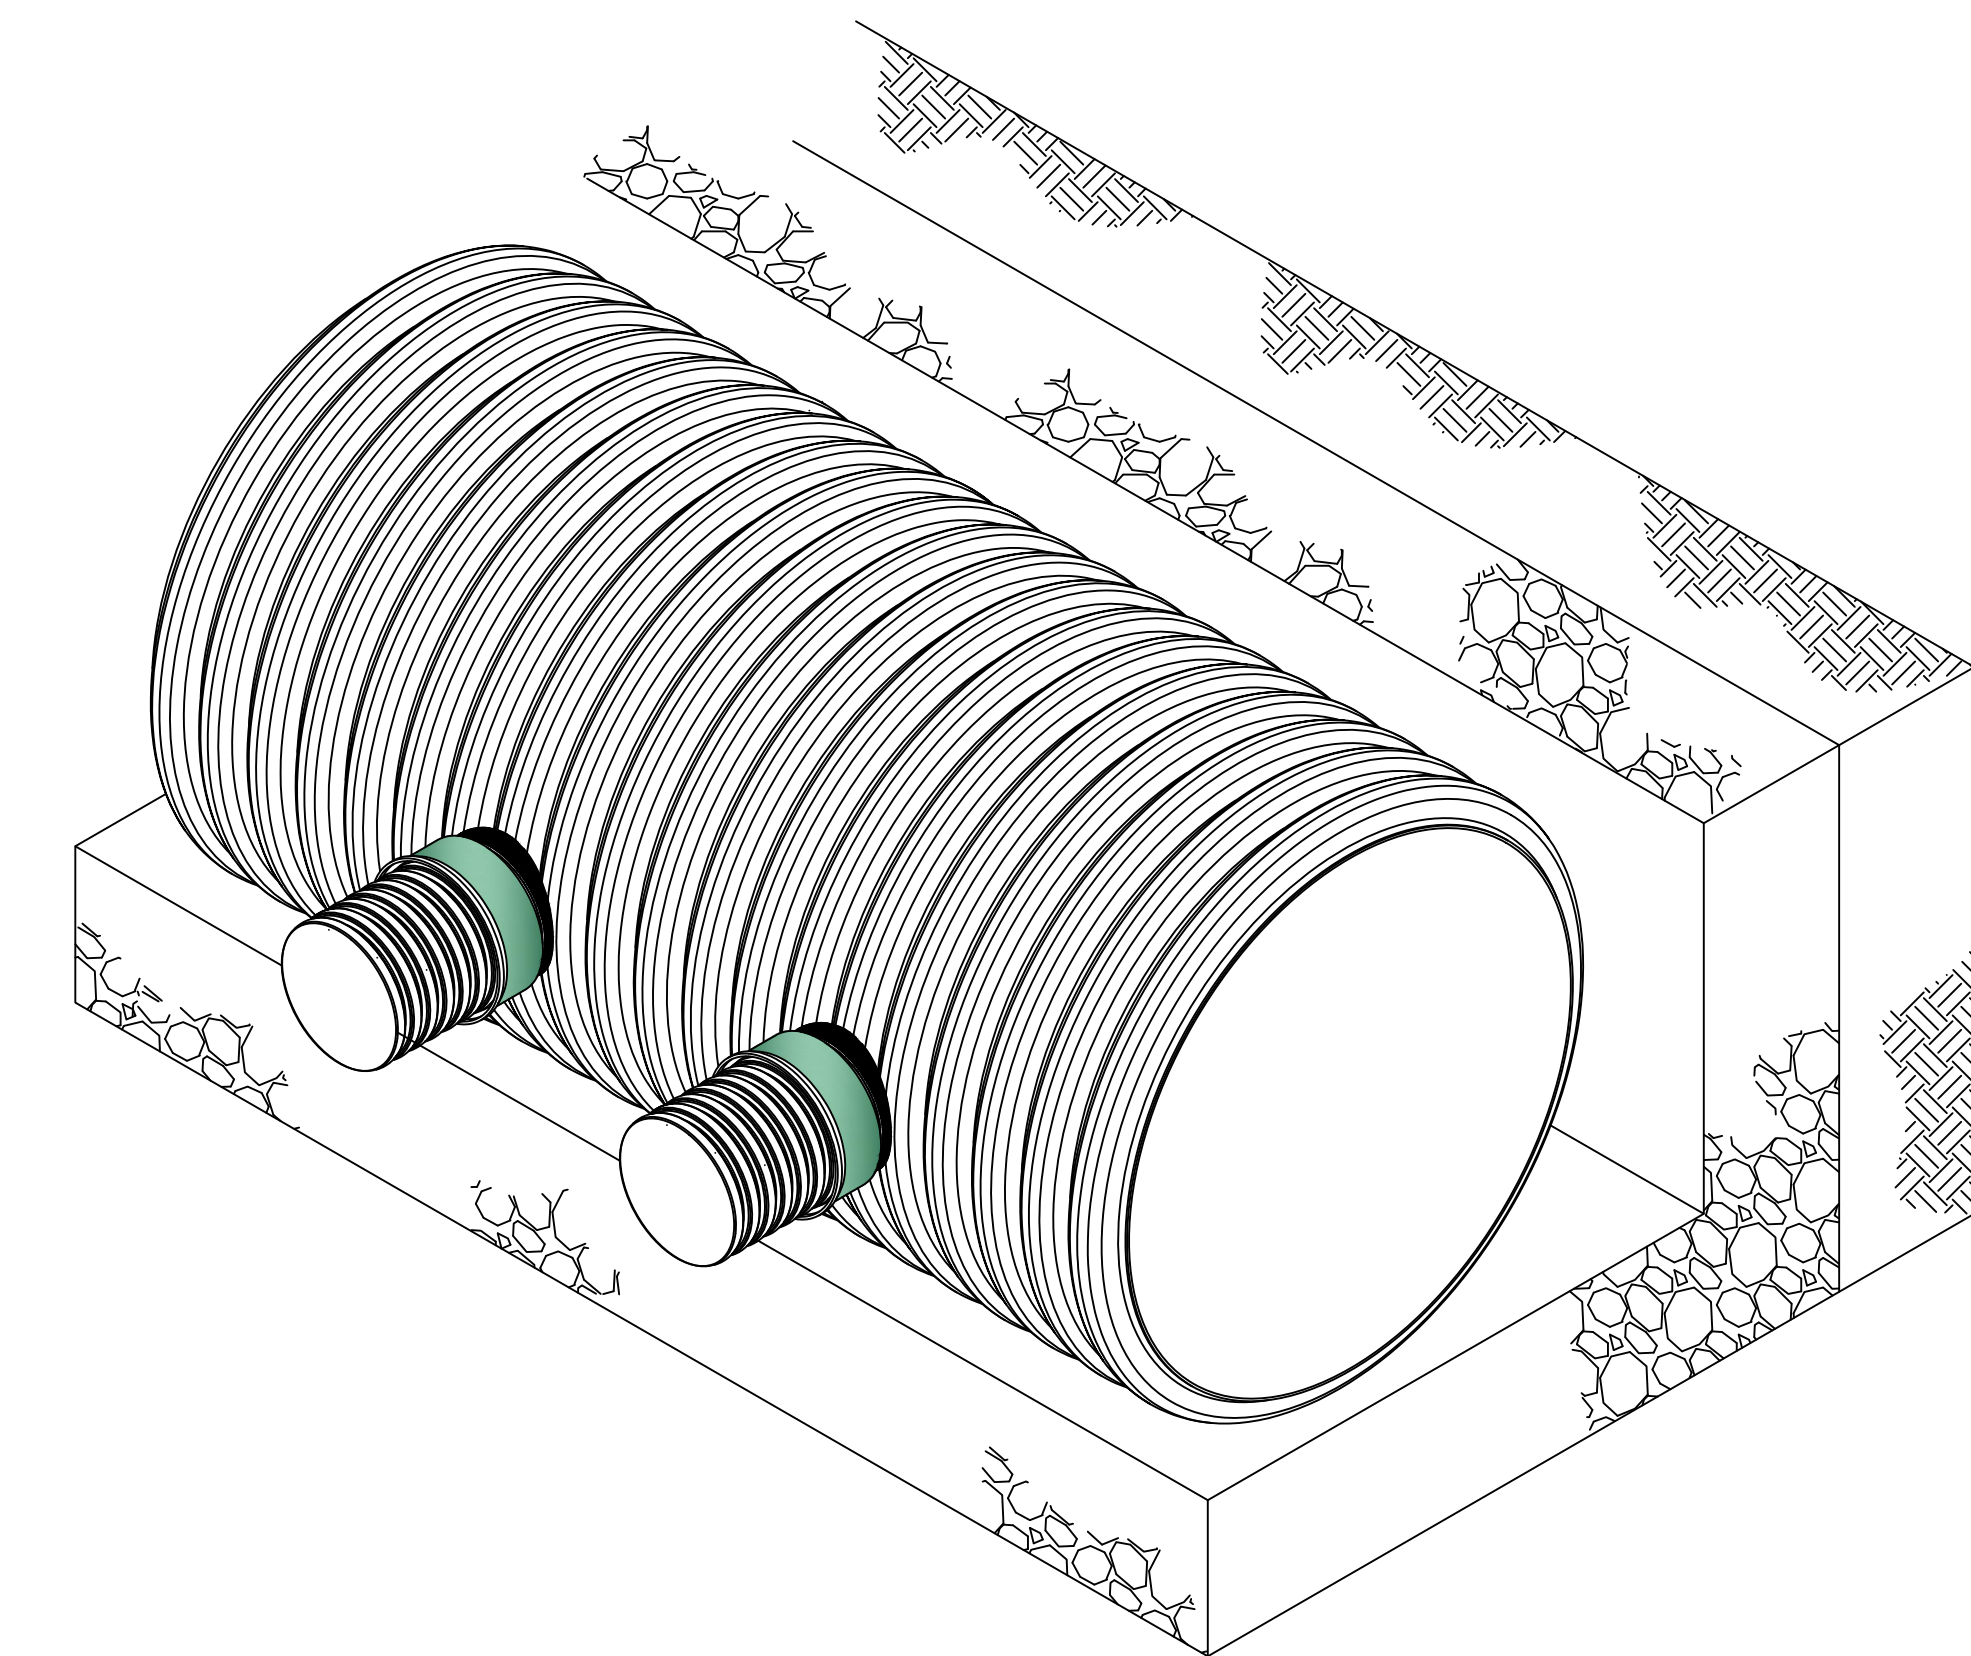

- Minimum spacing between parallel installations shall be no closer than the diameter of the lateral pipe and shall comply with lateral pipe manufacturer's recommendations.
- If side by side Inserta Tees are 6" in diameter or smaller, a minimum of 6" is required between the connections.
- Inserta Tee shall not be installed along pipe joints or pipe welds.

NOTE: FOR INSTALLATION INSTRUCTIONS, REFER TO DETAIL STD-1100. FOR PROTRUSION INFORMATION, REFER TO DETAIL STD-1101. FOR HOLE SAW INFORMATION, REFER TO DETAIL STD-1102.

ADVANCED DRAINAGE SYSTEMS, INC. ("ADS") HAS PREPARED THIS DETAIL BASED ON INFORMATION PROVIDED TO ADS. THIS DRAWING IS INTENDED TO DEPICT THE COMPONENTS AS REQUESTED. ADS HAS NOT PERFORMED ANY ENGINEERING OR DESIGN SERVICES FOR THIS PROJECT, NOR HAS ADS INDEPENDENTLY VERIFIED THE INFORMATION SUPPLIED. THE INSTALLATION DETAILS PROVIDED HEREIN ARE GENERAL RECOMMENDATIONS AND ARE NOT SPECIFIC FOR THIS PROJECT. THE DESIGN ENGINEER SHALL REVIEW THESE DETAILS PRIOR TO CONSTRUCTION. IT IS THE DESIGN ENGINEERS RESPONSIBILITY TO ENSURE THE DETAILS PROVIDED HEREIN MEETS OR EXCEEDS THE APPLICABLE NATIONAL, STATE, OR LOCAL REQUIREMENTS AND TO ENSURE THAT THE DETAILS PROVIDED HEREIN ARE ACCEPTABLE FOR THIS PROJECT.

INSERTA TEE PARALLEL  
SPACING DETAIL

DRAWING NUMBER STD-1120



4640 TRUEMAN BLVD  
HILLIARD, OH 43026

DRAWN BY:	HAK
DATE:	02/01/24
OK'S BY:	ENG
SCALE:	NTS
SHEET:	1