

INSPECTION & MAINTENANCE

- STEP 1) INSPECT ISOLATOR ROW FOR SEDIMENT
- REMOVE COVER FROM STRUCTURE AT UPSTREAM END OF ISOLATOR ROW
 - USING A FLASHLIGHT, INSPECT DOWN THE ISOLATOR ROW THROUGH OUTLET PIPE
 - MIRRORS ON POLES OR CAMERAS MAY BE USED TO AVOID A CONFINED SPACE ENTRY
 - FOLLOW OSHA REGULATIONS FOR CONFINED SPACE ENTRY IF ENTERING MANHOLE
 - IF SEDIMENT IS AT, OR ABOVE, 3" (80 mm) PROCEED TO STEP 2. IF NOT, PROCEED TO STEP 3.
- STEP 2) CLEAN OUT ISOLATOR ROW USING THE JETVAC PROCESS
- A FIXED CULVERT CLEANING NOZZLE WITH REAR FACING SPREAD OF 45" (1.1 m) OR MORE IS PREFERRED
 - APPLY MULTIPLE PASSES OF JETVAC UNTIL BACKFLUSH WATER IS CLEAN
 - VACUUM STRUCTURE SUMP AS REQUIRED
- STEP 3) REPLACE ALL COVERS, GRATES, FILTERS, AND LIDS; RECORD OBSERVATIONS AND ACTIONS.
- STEP 4) INSPECT AND CLEAN BASINS AND MANHOLES UPSTREAM OF THE AQUABOX SYSTEM.

NOTES

- INSPECT EVERY 6 MONTHS DURING THE FIRST YEAR OF OPERATION. ADJUST THE INSPECTION INTERVAL BASED ON PREVIOUS OBSERVATIONS OF SEDIMENT ACCUMULATION AND HIGH WATER ELEVATIONS.
- CONDUCT JETTING AND VACTORING ANNUALLY OR WHEN INSPECTION SHOWS THAT MAINTENANCE IS NECESSARY.

SIDES & TOP OF MODULES IN ISOLATOR ROW WRAPPED IN ONE LAYER OF ADSPLUS125 WOVEN GEOTEXTILE**

COVER PIPE CONNECTION TO SIDE PANEL WITH ADS GEOSYNTHETICS 601T NON-WOVEN GEOTEXTILE

COVER OPEN END OF ISOLATOR ROW WITH ADS GEOSYNTHETICS 601T NON-WOVEN GEOTEXTILE

INTERNAL SIDE PANEL TERMINATING ISOLATOR ROW ON OPPOSING MODULE

ELEVATED BYPASS MANIFOLD

SUMP DEPTH TBD BY SITE DESIGN ENGINEER (24" [600 mm] MIN RECOMMENDED)


18" [450 mm] INLET PIPE REQUIRED (INLET TO FULL MODULE)

** FOR AQUABOX-1.5 SYSTEMS WRAP ONLY THE FULL MODULE LAYER AS ISOLATOR ROW

ONE ADDITIONAL LAYER OF ADSPLUS125 WOVEN GEOTEXTILE BENEATH MODULES OF ISOLATOR ROW

SECTION A-A

NTS

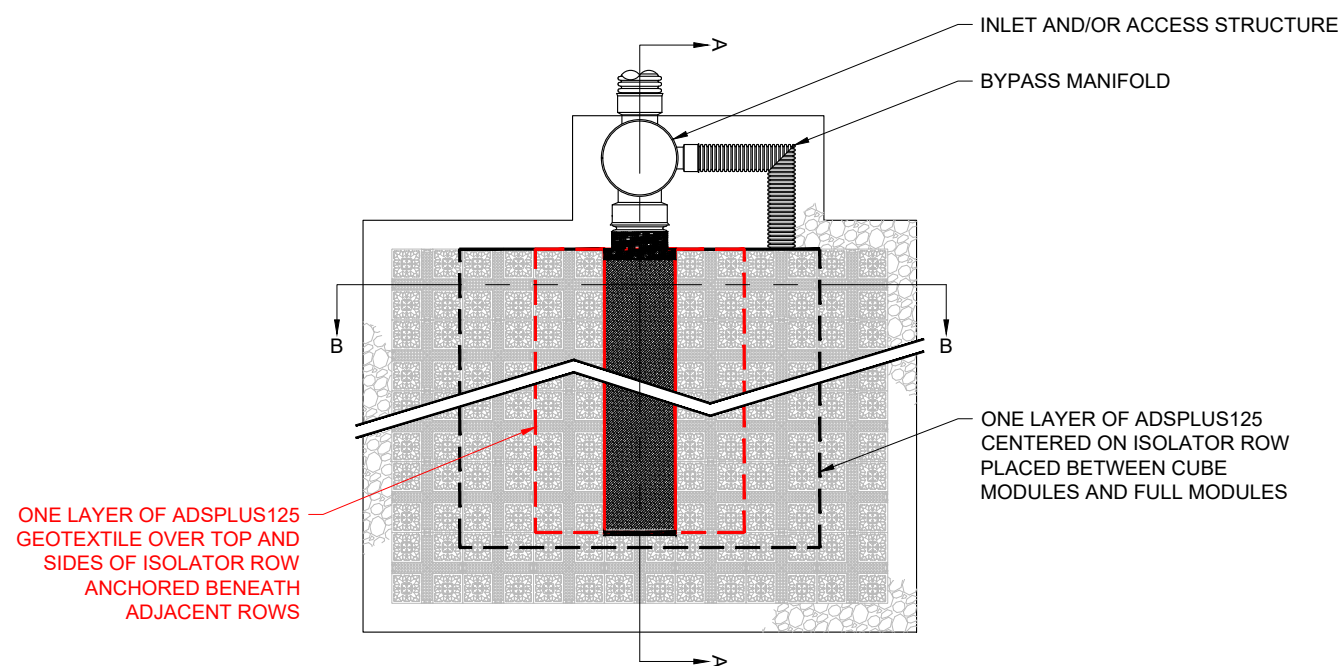


ISOLATOR ROW EXAMPLE

NTS

SIDES & TOP OF MODULES IN ISOLATOR ROW WRAPPED IN ONE LAYER OF ADSPLUS125 WOVEN GEOTEXTILE**

INTERNAL SIDE PANEL TERMINATING ISOLATOR ROW ON ADJACENT MODULE (TYP)

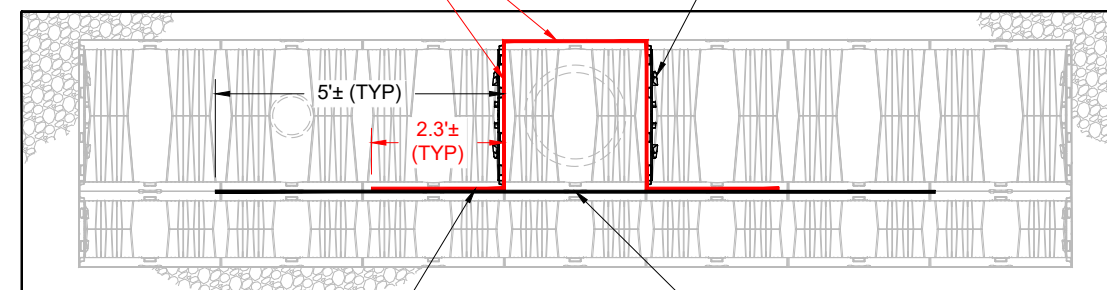

ADSPLUS125 WOVEN GEOTEXTILE OVER TOP AND SIDES OF ISOLATOR ROW ANCHORED BENEATH ADJACENT ROWS

ONE ADDITIONAL LAYER OF ADSPLUS125 WOVEN GEOTEXTILE BENEATH MODULES OF ISOLATOR ROW AND ADJACENT ROWS

** FOR AQUABOX-1.5 SYSTEMS WRAP ONLY THE FULL MODULE LAYER AS ISOLATOR ROW

SECTION B-B

NTS

ISOLATOR ROW DETAILS
AQUABOX-1.5

DATE: 08/20/24 DRAWN: SMW

DRAWING #: 773-015 CHECKED: JLM

DATE DRWN CHKD DESCRIPTION

Aquabox
Modular Stormwater Management System

4640 TRUEMAN BLVD
HILLIARD, OH 43026

ADS

THIS DRAWING HAS BEEN PREPARED BASED ON INFORMATION PROVIDED TO ADS UNDER THE DIRECTION OF THE SITE DESIGN ENGINEER OR OTHER PROJECT REPRESENTATIVE. THE SITE DESIGN ENGINEER SHALL REVIEW THIS DRAWING PRIOR TO CONSTRUCTION. IT IS THE ULTIMATE RESPONSIBILITY OF THE SITE DESIGN ENGINEER TO ENSURE THAT THE PRODUCT(S) DEPICTED AND ALL ASSOCIATED DETAILS MEET ALL APPLICABLE LAWS, REGULATIONS, AND PROJECT REQUIREMENTS.

1 SHEET
OF 1